


# Assignment III

Darman Alcin O.

17/11/2023/016

Designing for p8

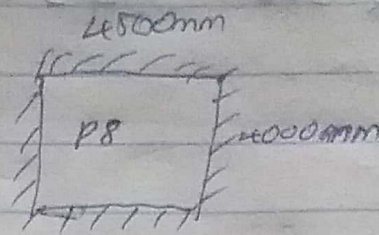

Capital / dropping = 1.2m

25 - concrete grade

Slab thickness = 250mm

Finishes = 1.2 k/m<sup>2</sup>

Partitions = 1.0 k/m<sup>2</sup>

Slab = 0.25 x 25 = 6 k/m<sup>2</sup>

Total = 8.2 k/m<sup>2</sup>

Designing by factory = 5.0

Area = 4.5 x 4 = 18 m<sup>2</sup>

D.L per area = 1.4 Gk + 1.6 Qk

$$= (1.4 \times 8.2 \times 18) + (1.6 \times 5 \times 18)$$

$$206.64 + 135$$

$$341.64$$

Short span → Middle strip → span

$$\text{span} = l_{oc} = \frac{2}{3} h = 4 - \frac{2}{3} \times 1.2 = 3200 \text{ mm}$$

$$\text{Moment} = 65\% \times 0.071 \text{ k} = \frac{45}{100} \times 0.071 \times 341.64 \times 4 = 43.60 \text{ k/m}$$



$$b = \frac{l_x}{2} = \frac{4000}{2} = 2000 \text{ mm}$$

$$d = h - \text{cover} - \frac{1}{2} \phi = 250 - 25 - 6 = 219 \text{ mm}$$

$$k = \frac{M}{bd^2} = \frac{43.66 \times 10^6}{2000 \times 219^2} = 0.018$$

$$l_a = 0.5 + \sqrt{0.25 - \frac{k}{25}} = 0.5 + \sqrt{0.25 - \frac{0.018}{25}} = 0.979 > 0.95 = 0.95$$

$$z = l_a \cdot d = 0.95 \times 219 = 208.05$$

$$A_s = \frac{M}{0.95fyz} = \frac{43.66 \times 10^6}{0.95 \times 410 \times 208.05} = 538.8$$

Provide y12 @ 200 c/c ( $A_s = 566 \text{ mm}^2$ )



## Sport

$$M_2 = 25\% \times 0.071 kL = \frac{25}{100} \times 0.071 \times 344.674 \times 4 = 24.25$$

$$l = 2000 \text{ m} = b$$

$$k = \frac{24.25 \times 10^6}{2000 \times 219^2 \times 25} = 0.01$$

$$P_a = 0.5 + \sqrt{0.25 - \frac{0.01}{0.9}} = 0.989 > 0.95 = 0.95$$

$$z = P_a \cdot d = 0.95 \times 219 = 208.05$$

$$A_s = \frac{24.25 \times 10^6}{2000 \times 219^2 \times 25} = \frac{24.25 \times 10^6}{0.95 \times 208.05 \times 410} = 299.25$$

Provide  $\varnothing 10 @ 300 \text{ c/c}$  ( $A_s = 377 \text{ mm}^2$ )

## Column strip (span)

$$l_{\text{span}} = 3200 \text{ mm}$$

$$b = 2000 \text{ mm}$$

$$M = 55\% \cdot 0.071 kL = \frac{55}{100} \times 0.071 \times 364.66 \times 4.5 = 53.36 \text{ kNm}$$

$$k = \frac{M}{b l^3} = \frac{53.36 \times 10^6}{2000 \times 219^2 \times 25} = 0.022$$

$$P_a = 0.5 + \sqrt{0.25 - \frac{0.022}{0.9}} = 0.977 > 0.95 = 0.95$$

$$z = P_a \cdot d = 0.95 \times 219 = 208.05$$

$$A_s = \frac{53.36 \times 10^6}{0.95 \times 410 \times 208.05} = 658.47$$

Provide  $\varnothing 12 @ 150 \text{ c/c}$  ( $A_s = 754 \text{ mm}^2$ )



Strip (Support)

$$M = \frac{75}{100} \times 0.071 \times 34160 \times 4.5 = 72.07 \approx 72.77$$

$$k = \frac{72.77 \times 10^6}{2000 \times 219^2 \times 25} = 0.030$$

$$k_{or} = 0.5 + \sqrt{0.25 - \frac{0.030}{0.9}} = 0.967 \approx 0.95$$

$$Z = 208.05$$

0.95

$$A_s = \frac{0.95 \times 72.77 \times 10^6}{208.05 \times 410 \times 0.95} = 9150.44 \approx 848$$

Provide  $\forall 12 @ 105/c$  ( ~~$A_s = 9150$~~ ) ( $A_s = 9105$  mm)

Overlapped  $\rightarrow$  middle strip  $\rightarrow$  (span)

$$\text{Effective span} = l_y - \frac{2}{3}h = 4.5 - \frac{2}{3} \times 1.2 = 3700 \text{ mm}$$

$$\text{Moment} = 0.45 \times 0.071 \times 341.66 \times 4.5 = 81.99 \approx 49.12$$

$$\text{Width} = b = l_y - \frac{a}{2} = 4.5 - 2 = 2.5 = 2500$$

$$k = \frac{81.99 \times 10^6}{2500 \times 219^2 \times 25} = 0.018$$

$$2500 \times 219^2 \times 25$$

$$k_{or} = 0.5 + \sqrt{0.25 - \frac{0.018}{0.9}} = 0.987 \approx 0.95$$

$$Z = 208.05$$

$$A_s = \frac{0.95 \times 81.99 \times 10^6}{208.05 \times 410} = 606.45$$

$$0.95 \times 208.05 \times 410$$

Provide  $\forall 12 @ 175/c$  ( $A_s = 666$  mm)



Sybil

$$M = 0.25 = 0.071 \times 30167 \times 0.5 = 29.81$$

$$b = 2500$$

$$d = 219$$

$$k = \frac{29.89 \times 10^6}{2500 \times 219^2 \times 25} = 9.18 \times 10^{-3}$$

$$l_a = 0.5 + \sqrt{0.25 - \frac{9.18 \times 10^{-3}}{0.9}} = 0.9897 \times 0.95 = 0.95$$

$$z = l_a \cdot d = 208.05$$

$$A_s = \frac{29.89 \times 10^6}{0.95 \times 208.05 \times 410} = 396.96$$

Provide  $412 @ 300 c/c$  ( $A_s = 377 mm^2$ )

Column strip

$$\text{span} = 3700 \text{ mm}$$

$$\text{width} = \frac{l_x}{2} = 2000 \text{ mm}$$

$$\text{Moment} = 0.55 \times 0.071 \times 30167 \times 0.5 = 60.00$$

$$k = \frac{60.00 \times 10^6}{2000 \times 219^2 \times 25} = 0.025$$

$$l_a = 0.5 + \sqrt{0.25 - \frac{0.025}{0.9}} = 0.977 \times 0.95 = 0.93$$

$$z = 208.05$$

$$A_s = \frac{60.00 \times 10^6}{0.95 \times 208.05 \times 410} = 720.91$$

Provide  $412 @ 150 c/c$  ( $A_s = 786$ )



Support

$$\text{Moment} = 0.75 \times 0.021 \times 341.62 \times 4.5 = 81.87$$


$$k = \frac{81.87 \times 10^6}{20000 \times 219^2 \times 25} = 0.034$$

$$l_0 = 0.5 + \sqrt{0.25 - \frac{0.034}{0.9}} = 0.967 \text{ or } 0.95$$

$$Z = 208.05$$

$$A_s = \frac{81.87 \times 10^6}{0.95 \times 410 \times 208.05} = 1010.298$$


Provide V12 @ 100 c/c (A<sub>s</sub> = 1130)

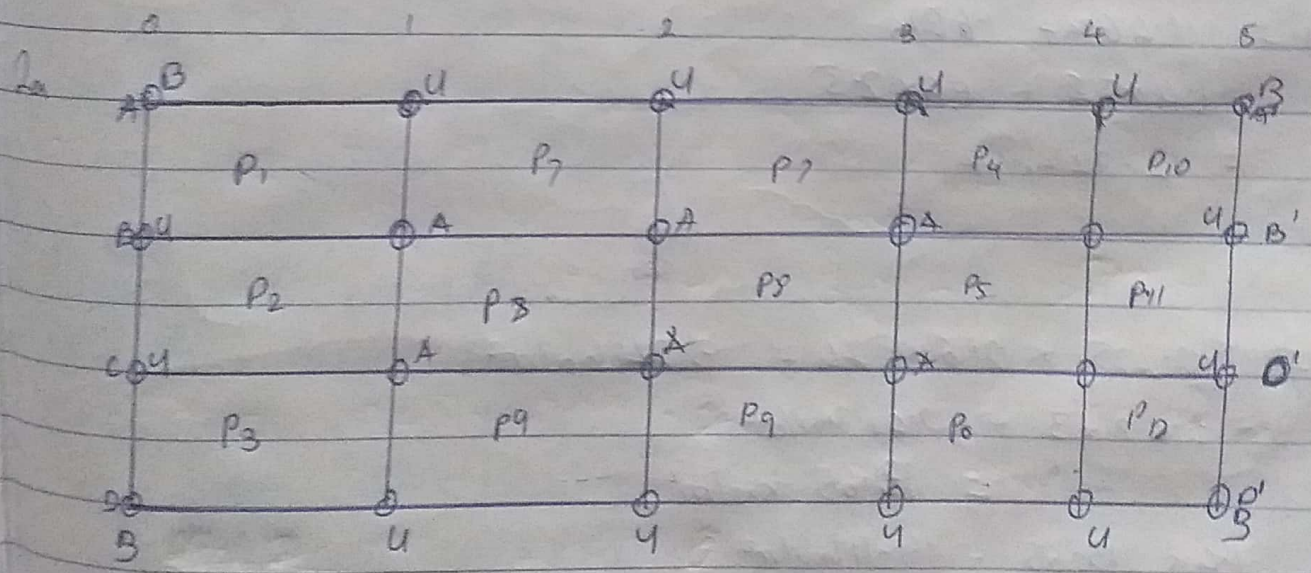

key = A = Axial  
 B = Biaxially  
 U = Unioaxially



## Designing for column B1

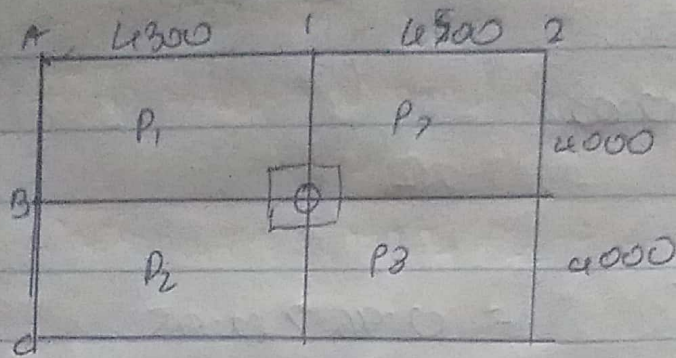

$$A = 4 \times 4.38 = 17.6 \text{ m}^2$$

### Slab Load

$$\text{Weight of slab} = 0.15 \times 24 = 3.6 \text{ kN/m}^2$$

$$\text{Finished} = 1.2 \text{ kN/m}^2$$

$$\text{Partition} = 1.0 \text{ kN/m}^2$$

$$5.8 \text{ kN/m}^2$$

$$\text{Design Load} = 1.4 \times 5.8 + 1.6 \times 2.5$$

$$1.4 \times 5.8 + 1.6 \times 2.5$$

$$= 12.12 \text{ kN/m}^2$$

### Beam Load

$$\text{beam wt} = 0.225 \times 0.6 \times 24 = 3.24 \text{ kN/m}^2$$

$$\text{wall load} = 3.47 \times 3 = 10.41 \text{ kN/m}^2$$

$$= 13.65 \text{ kN/m}^2$$

$$\text{DL} = 1.4 \times 13.65 = 19.11 \text{ kN/m}^2$$

### Design

Roof - 3rd Floor

$$\text{Roof load} = A_{\text{area}} \times 1.5 \times 1.5$$

$$= 17.6 \times 1.5^2 = 39.6 \text{ kN}$$

$$\text{Roof beam} = 0.225 \times 0.45 \times 24 = 2.43 \text{ kN/m}^2$$

$$\text{Finished} = 1.0 \text{ kN/m}^2$$

$$= 3.43 \text{ kN/m}^2$$



$$\text{Load from} = 3.42 (1.14 \times 1.14)$$

$$\text{Column load} = 10 \text{ kN}$$

$$\text{Total load} = 89.94 \text{ kN}$$

3rd floor  $\rightarrow$  2nd floor

$$\text{Load from above} = 89.94 \text{ kN}$$

$$\text{Column load} = 10 \text{ kN}$$

$$\text{Slab load} = 12.6 \times 12 \times 12 = 213.312 \text{ kN}$$

$$\text{Beam load} = 19.11 \times (8.4) = 160.524 \text{ kN}$$

$$\text{Total} \Rightarrow 463.776 \text{ kN}$$

2nd floor to 1st floor

$$\text{Load from above} = 463.78 \text{ kN}$$

$$\text{Column load} = 10 \text{ kN}$$

$$\text{Slab} = 213.312 \text{ kN}$$

$$\text{Wall \& beam} = 160.524 \text{ kN}$$

$$\text{Total} \Rightarrow 856.61 \text{ kN}$$

1st floor to ground floor

$$\text{Load from above} = 856.61 \text{ kN}$$

$$\text{Column load} = 10 \text{ kN}$$

$$\text{slab} = 213.312 \text{ kN}$$

$$\text{Wall \& beam} = 160.524$$

$$= 1249.45 \approx 1300 \text{ kN}$$

$$A_{sc} \quad N = 0.85 f_{cu} b h$$

$$0.7 f_y = 0.35 f_{cu}$$

$$N = 1300 \text{ kN}$$

$$f_{cu} = 25$$

$$f_y = 410$$

$$b = 225$$



$$A_s = \frac{1300 \times 10^6 - 0.95 (225 \times 225^2)}{0.7 \times 410 - 0.35 \times 25}$$

$$= 3080.07 \text{ mm}^2$$

Provide 8 y 25 (  $A_s = 3930 \text{ mm}^2$  )

$$A_{s \text{ min}} = 0.4\% bh = 0.004 \times 225^2 = 202.5 \text{ mm}^2$$